


ALL DEVICES

1. ANY DEVICE REQUESTED TO BE INSTALLED BETWEEN THE METER AND THE METER SOCKET MUST BE PRE-APPROVED BY CITY.
2. AT THE CITY'S DISCRETION, CITY WILL ONLY APPROVE DEVICES WHICH WILL NOT ADVERSELY:
 - (a.) IMPACT THE ACCURACY OF THE CITY'S METER
 - (b.) IMPACT CITY'S ABILITY TO READ THE METER
 - (c.) AFFECT SERVICE TO, OR USE OF SERVICE BY, THE CUSTOMER OR OTHER CUSTOMERS
3. ANY PARTY DESIRING TO INSTALL A DEVICE BETWEEN THE METER AND THE METER SOCKET MUST OBTAIN A PERMIT OR MAKE OTHER SUITABLE ARRANGEMENTS WITH THE ELECTRICAL INSPECTION AUTHORITY PRIOR TO INSTALLING SUCH DEVICES. IF OTHER SUITABLE ARRANGEMENTS ARE MADE, A COPY OF THE ARRANGEMENT MUST BE ON FILE WITH CITY.
4. ALL INSTALLERS OF DEVICES BETWEEN THE METER AND THE METER SOCKET MUST SCHEDULE THEIR INSTALLATION WITH CITY TO MINIMIZE INTERRUPTION OF SERVICE TO THE CUSTOMER. FUNCTIONS THAT MUST BE SCHEDULED ARE:
 - (a.) METER REMOVAL
 - (b.) ELECTRICAL INSPECTION AFTER THE DEVICE IS INSTALLED (IF REQUIRED)
 - (c.) REINSTALLATION OF THE METER
5. PRIOR TO INSTALLING THE DEVICE, THE INSTALLER MUST INSPECT THE METER SOCKET, CHECK THE GROUNDING CONDUCTOR AND GROUND TO ENSURE THE INSTALLATION IS NEC AND UL APPROVED.

REINSTALLATION OF THE METER

1. ENSURE INSPECTION REQUIREMENTS HAVE BEEN COMPLETED.
2. CHECK FOR GROUNDING CONTINUITY THROUGH THE DEVICE TO ENSURE THE METER WILL BE GROUNDED WHEN IT IS INSTALLED.

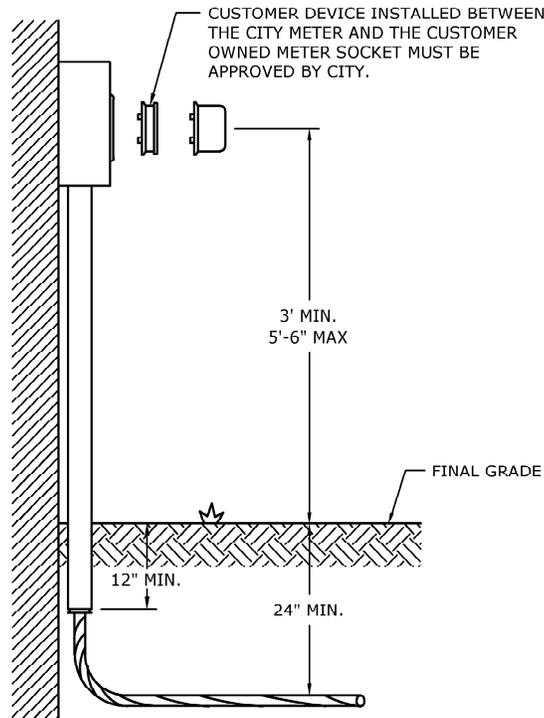

3			
2			
1			
0	0/19/11	CADD GRAPHICS	OBT
REVISED	BY	APPR.	

DEVICES INSTALLED BETWEEN
THE METER AND THE METER SOCKET

ELECTRICITIES
OF NORTH CAROLINA, INC.

SCALE NO SCALE	DWG. QA-5EC
-------------------	----------------