


- NOTES:
1. ALL CONCRETE SHALL BE 3000 PSI.
 2. CURB SHALL BE TAPERED TO FINISH FLUSH WITH SIDEWALK.
 3. CONCRETE DRIVEWAY APRONS, SIDEWALKS (WHEN CROSSING DRIVEWAYS), AND CONCRETE DRIVEWAY TIE-INS SHALL BE 6" THICK, MINIMUM.
 4. RESIDENTIAL DRIVEWAY TO BE 13' MIN TO 24' MAX IN WIDTH.
 5. BEGINNING RADIUS SHALL NOT ENCROACH ON ADJACENT PROPERTIES BASED ON A PROJECTION OF PROPERTY LINE FROM THE RIGHT-OF-WAY TO THE CURB LINE.



SECTION A-A

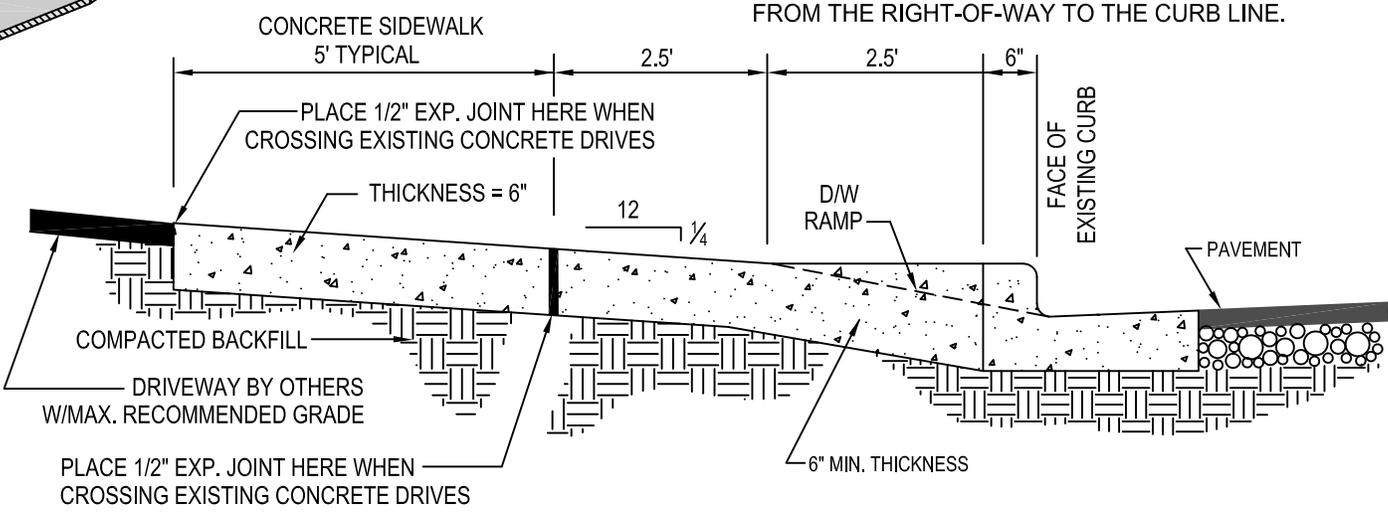

CITY OF STATESVILLE

PUBLIC WORKS DEPARTMENT

STREET

Residential Driveway Cut

DETAIL #	REVISED
ST-8	DEC 2010
SCALE:	SHEET #
N.T.S.	1 OF 1